


30902 ECBT-GNF

Earthing and short-circuit kit for low-voltage distribution boards.
The main reason for their installation is to protect the worker from accidental power-on or return of voltage during repair work.
With insulated pole for extracting blades using M-10 screw.
According to IEC 61230 standard.

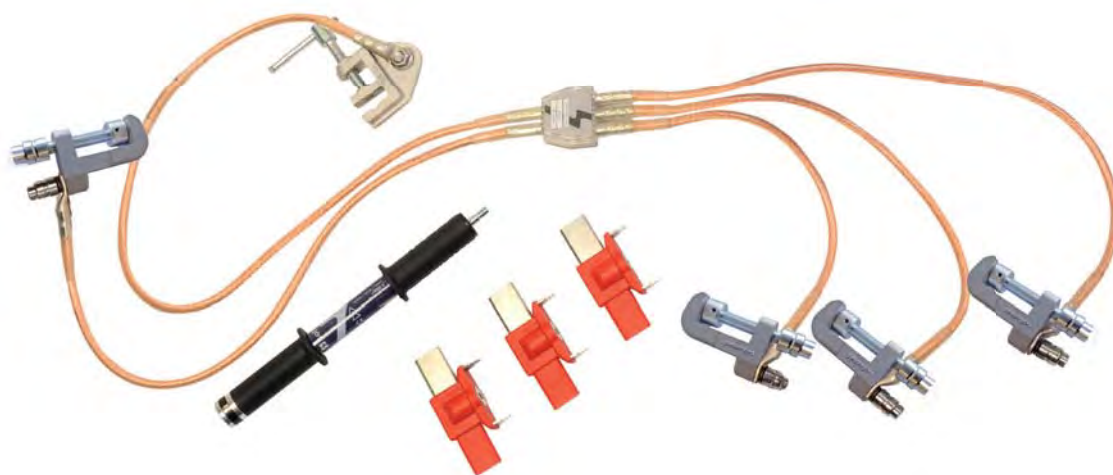

Low voltage

Composed of:

- 3 disconnecting and earthing NH1-3 blades.
- 4 disconnecting and earthing MPUC clamp.
- 3 copper PVC-insulated cables 35/50 mm² section and 0.45 - 0.60 - 0.85 m long for short circuit of phases.
- 1 copper PVC-insulated cables 35/50 mm² section and 0.75 m long for neutral.
- 1 copper PVC-insulated cables 35/50 mm² section and 1 m long for earthing.
- 1 branch-joint connector (5 cables).
- 1 insulated pole for placing blades.
- 1 TT-38A earthing lathe.
- 1 nylon bag to store and transport the equipment.



Code	Ref.	Section	Short circuit current Max. ICC
659170	ECBT-GNF/35	35 mm ²	9 kA/1s
659180	ECBT-GNF/50	50 mm ²	12 kA/1s



MPUC
Earthing clamp



TT-38A
Earthing lathe



NH1-3
Disconnecting and earthing blade