
Earthing devices / Low-voltage electric panels

Earthing and short-circuit equipment with 4 insulated PTA clamps

30902 ECBT-PTA4

Version with four PTA clamps, designed for short-circuiting the three phases and the neutral, for connection to screw heads mounted on the bars or busbars of electric panels.

According to IEC 61230 standard.

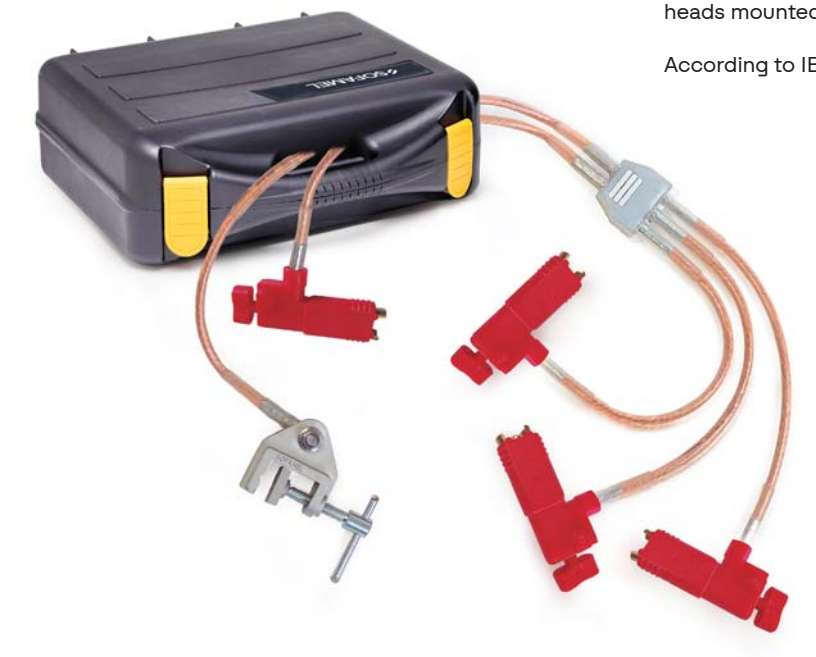



PTA



TT-38A

Composed of:

- 4 insulated PTA earth clamps for phase and neutral short-circuiting.
- 3 copper PVC-insulated cables, 25 mm² cross-section, 1.2 m long for phase short-circuiting.
- 1 copper PVC-insulated cable, 25 mm² cross-section, 1.5 m long for neutral earthing.
- 1 copper PVC-insulated cable, 25 mm² cross-section, 2 m long for earthing.
- 1 5-way branch connector.
- 1 TT-38A earthing lathe.
- 1 plastic case for storing and transporting the equipment.

Code	Ref.	Cable section (mm²)	Length (m)	⬡ / Ø max.	Short-circuit current Max. ICC
659150	**ECBT-PTA4**	25	1.2 / 1.5 / 2	8 - 22 mm	6.9 kA/1s