


30902 ECBT-ID

Earthing and short-circuit kit for low-voltage distribution boards.
The main reason for their installation is to protect the worker from accidental power-on or return of voltage during repair work.
With insulated pole for extracting blades using M-10 screw.
According to IEC 61230 standard.

Low voltage

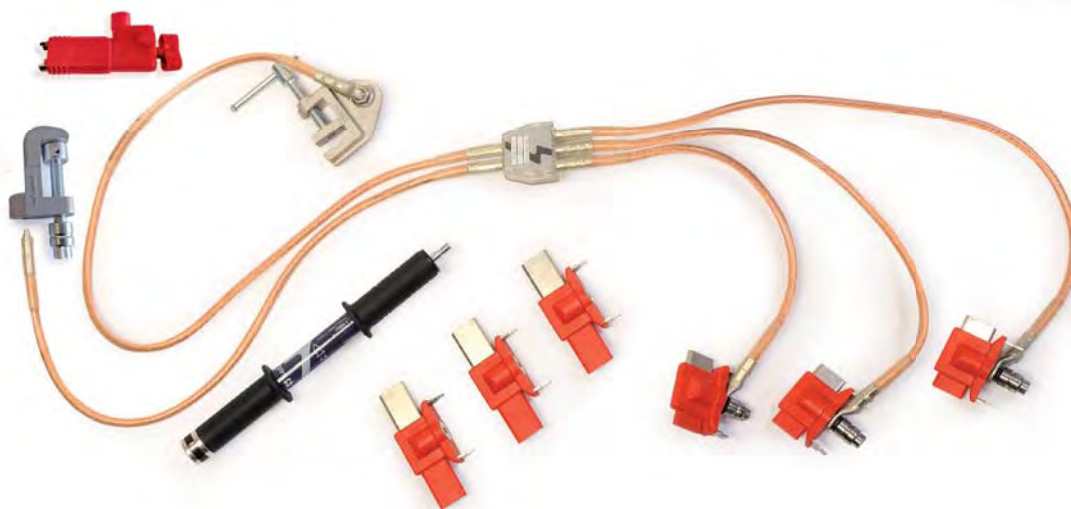

Composed of:

- 3 disconnecting and earthing NH00 blades.
- 3 disconnecting and earthing NH1-3 blades.
- 3 copper PVC-insulated cables 25 mm² section and 0.45 - 0.60 - 0.85 m long for short circuit of phases.
- 1 m copper PVC-insulated cables 25 mm² section and 0.75 m long for neutral.
- 1 m copper PVC-insulated cables 25 mm² section and 1 m long for earthing.
- 1 insulated PTA neutral clamp.
- 1 MPUCN neutral clamp.
- 1 insulated pole for placing blades.
- 1 TT-38A earthing lathe.
- 1 plastic case for storage and transport.
- 1 branch-joint connector (5 ends).

| Code | Ref. | Short circuit current Max. ICC |
|--------|---------|-----------------------------------|
| 659160 | ECBT-ID | 6.9 kA/1s |



MPUCN
Neutral clamp



PTA
Insulated
neutral clamp



TT-38A
Earthing lathe



NH1-3
Disconnecting and
earthing blade



NH00
Disconnecting and
earthing blade