



# Earthing & Short Circuit Protection Equipment


Safety

Low voltage electric panels


SAFETY CATALOGUE

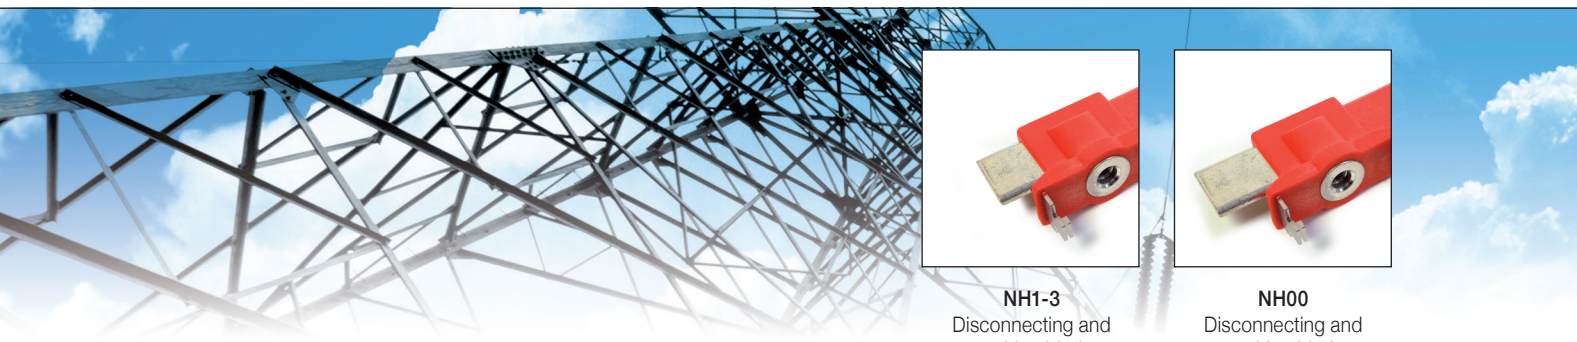

**NH1-3**  
Disconnecting and earthing blade



**NH00**  
Disconnecting and earthing blade

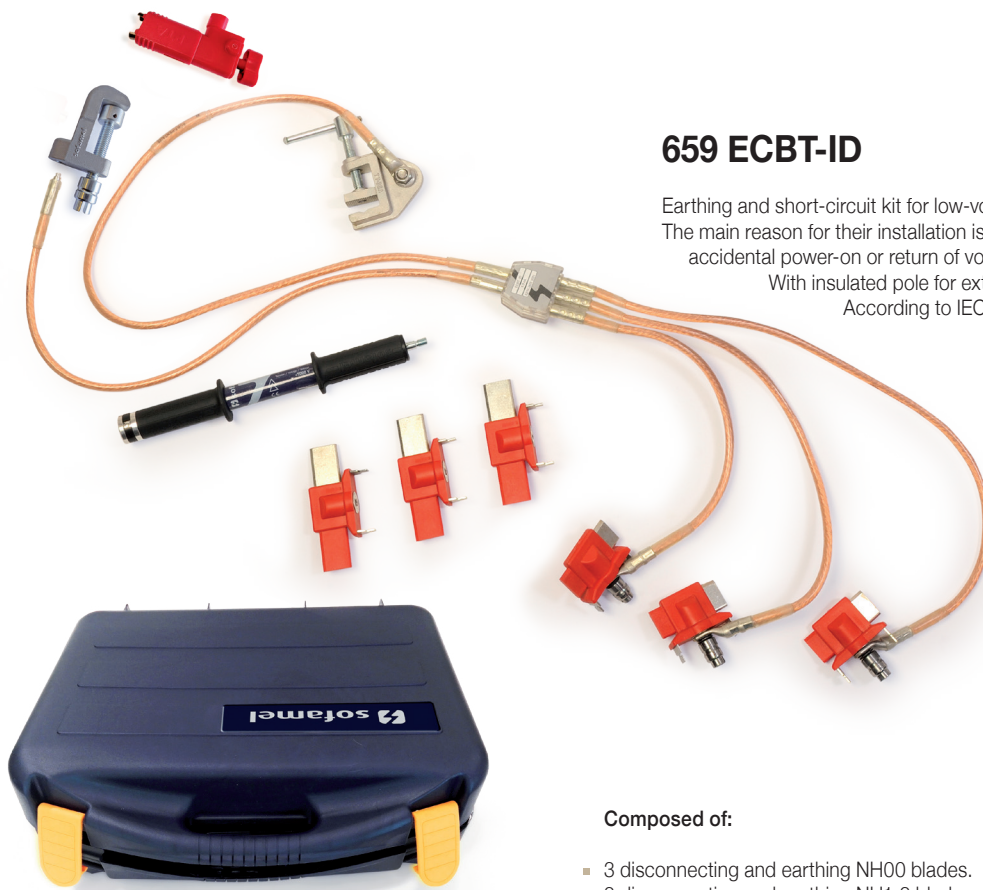

## 659 ECBT-ID

Earthing and short-circuit kit for low-voltage distribution boards. The main reason for their installation is to protect the worker from accidental power-on or return of voltage during repair work.

With insulated pole for extracting blades using M-10 screw. According to IEC 61230 standard.

### Composed of:


- 3 disconnecting and earthing NH00 blades.
- 3 disconnecting and earthing NH1-3 blades.
- 3 copper PVC-insulated cables 25 mm<sup>2</sup> section and 0.45 - 0.60 - 0.85 m long for short circuit of phases.
- 1 m copper PVC-insulated cables 25 mm<sup>2</sup> section and 0.75 m long for neutral.
- 1 m copper PVC-insulated cables 25 mm<sup>2</sup> section and 1 m long for earthing.
- 1 insulated PTA neutral clamp.
- 1 MPUCN neutral clamp.
- 1 insulated pole for placing blades.
- 1 TT-38A earthing lathe.
- 1 plastic case for storage and transport.
- 1 branch-joint connector ( 5 ends)



**MPUCN**  
Neutral clamp



**PTA**  
Insulated neutral clamp



**TT-38A**  
Earthing lathe

Code	Ref.	Short circuit current Max. ICC
<b>659160</b>	<b>ECBT-ID</b>	6.9 KA/1s