


30902 ECBT-ID-NH

Earthing and short-circuit kit for low-voltage distribution boards.
 The main reason for their installation is to protect the worker from accidental power-on or return of voltage during repair work.
 With insulated pole for extracting blades using M-10 screw.
 According to IEC 61230 standard.

Low voltage

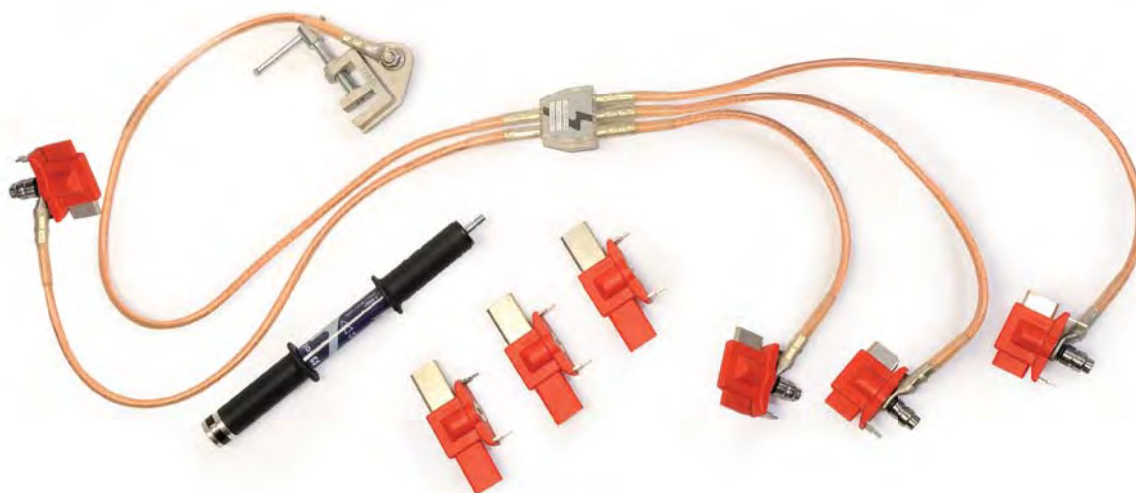

Composed of:

- 4 disconnecting and earthing NH00 blades.
- 4 disconnecting and earthing NH1-3 blades.
- 3 copper PVC-insulated cables 16 mm² section and 0.50 m long for short circuit of phases.
- 1 copper PVC-insulated cables 16 mm² section and 0.50 m long for neutral.
- 1 copper PVC-insulated cables 16 mm² section and 1 m long for earthing.
- 1 branch-joint connector (5 cables).
- 1 insulated pole for placing blades.
- 1 TT-38A earthing lathe.
- 1 nylon bag to store and transport the equipment.



Code	Ref.	Short circuit current Max. ICC
659217	ECBT-ID-NH	6.9 kA/1s



TT-38A
Earthing lathe



NH1-3
Disconnecting and earthing blade



NH00
Disconnecting and earthing blade